

NOTES:

- UNIT MUST HAVE CLEARANCES FOR AIRFLOW AS FOLLOWS:
TOP-DO NOT RESTRICT IN ANY WAY
COIL SIDE- 3 1/2 FT. [1067mm] FROM SOLID SURFACE
SIDE, ENDS-3FT. [914mm] FROM SOLID SURFACE (FOR SERVICE ACCESS)
- COIL SIDE CLEARANCE WITH ACCESSORY HAIL GUARD INSTALLED IS 3 FT. [914mm] TO OUTSIDE EDGE OF HAIL GUARD TOP PANEL.
- COILSIDE CLEARANCE FOR MULTIPLE CHILLER INSTALLATION IS 6 FT. [1981mm].
- FLOW SWITCH AND STRAINER ARE FACTORY INSTALLED IN ENTERING FLUID PIPING.




UNITED TECHNOLOGIES SYRACUSE, NY
CARRIER P.O. BOX 4808 13221

THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

UNIT	DIM. A	DIM. B	DIM. C	TOTAL OPERATING WEIGHT - AL. FIN		TOTAL OPERATING WEIGHT - CU. FIN	
				LBS.	KG.	LBS.	KG.
30RA010-60Hz	33.75 [857]	22.00 [559]	21.00 [533]	945	428	1024	464
30RA010-50Hz	33.75 [857]	22.00 [559]	21.00 [533]	975	442	1056	479
30RA015-60Hz	34.00 [864]	21.50 [546]	21.00 [533]	1066	483	1197	543
30RA015-50Hz	29.75 [756]	17.87 [454]	21.00 [533]	1190	540	1321	599
30RA018-60Hz	32.12 [816]	20.12 [511]	21.00 [533]	1205	547	1334	605
30RA018-50Hz							

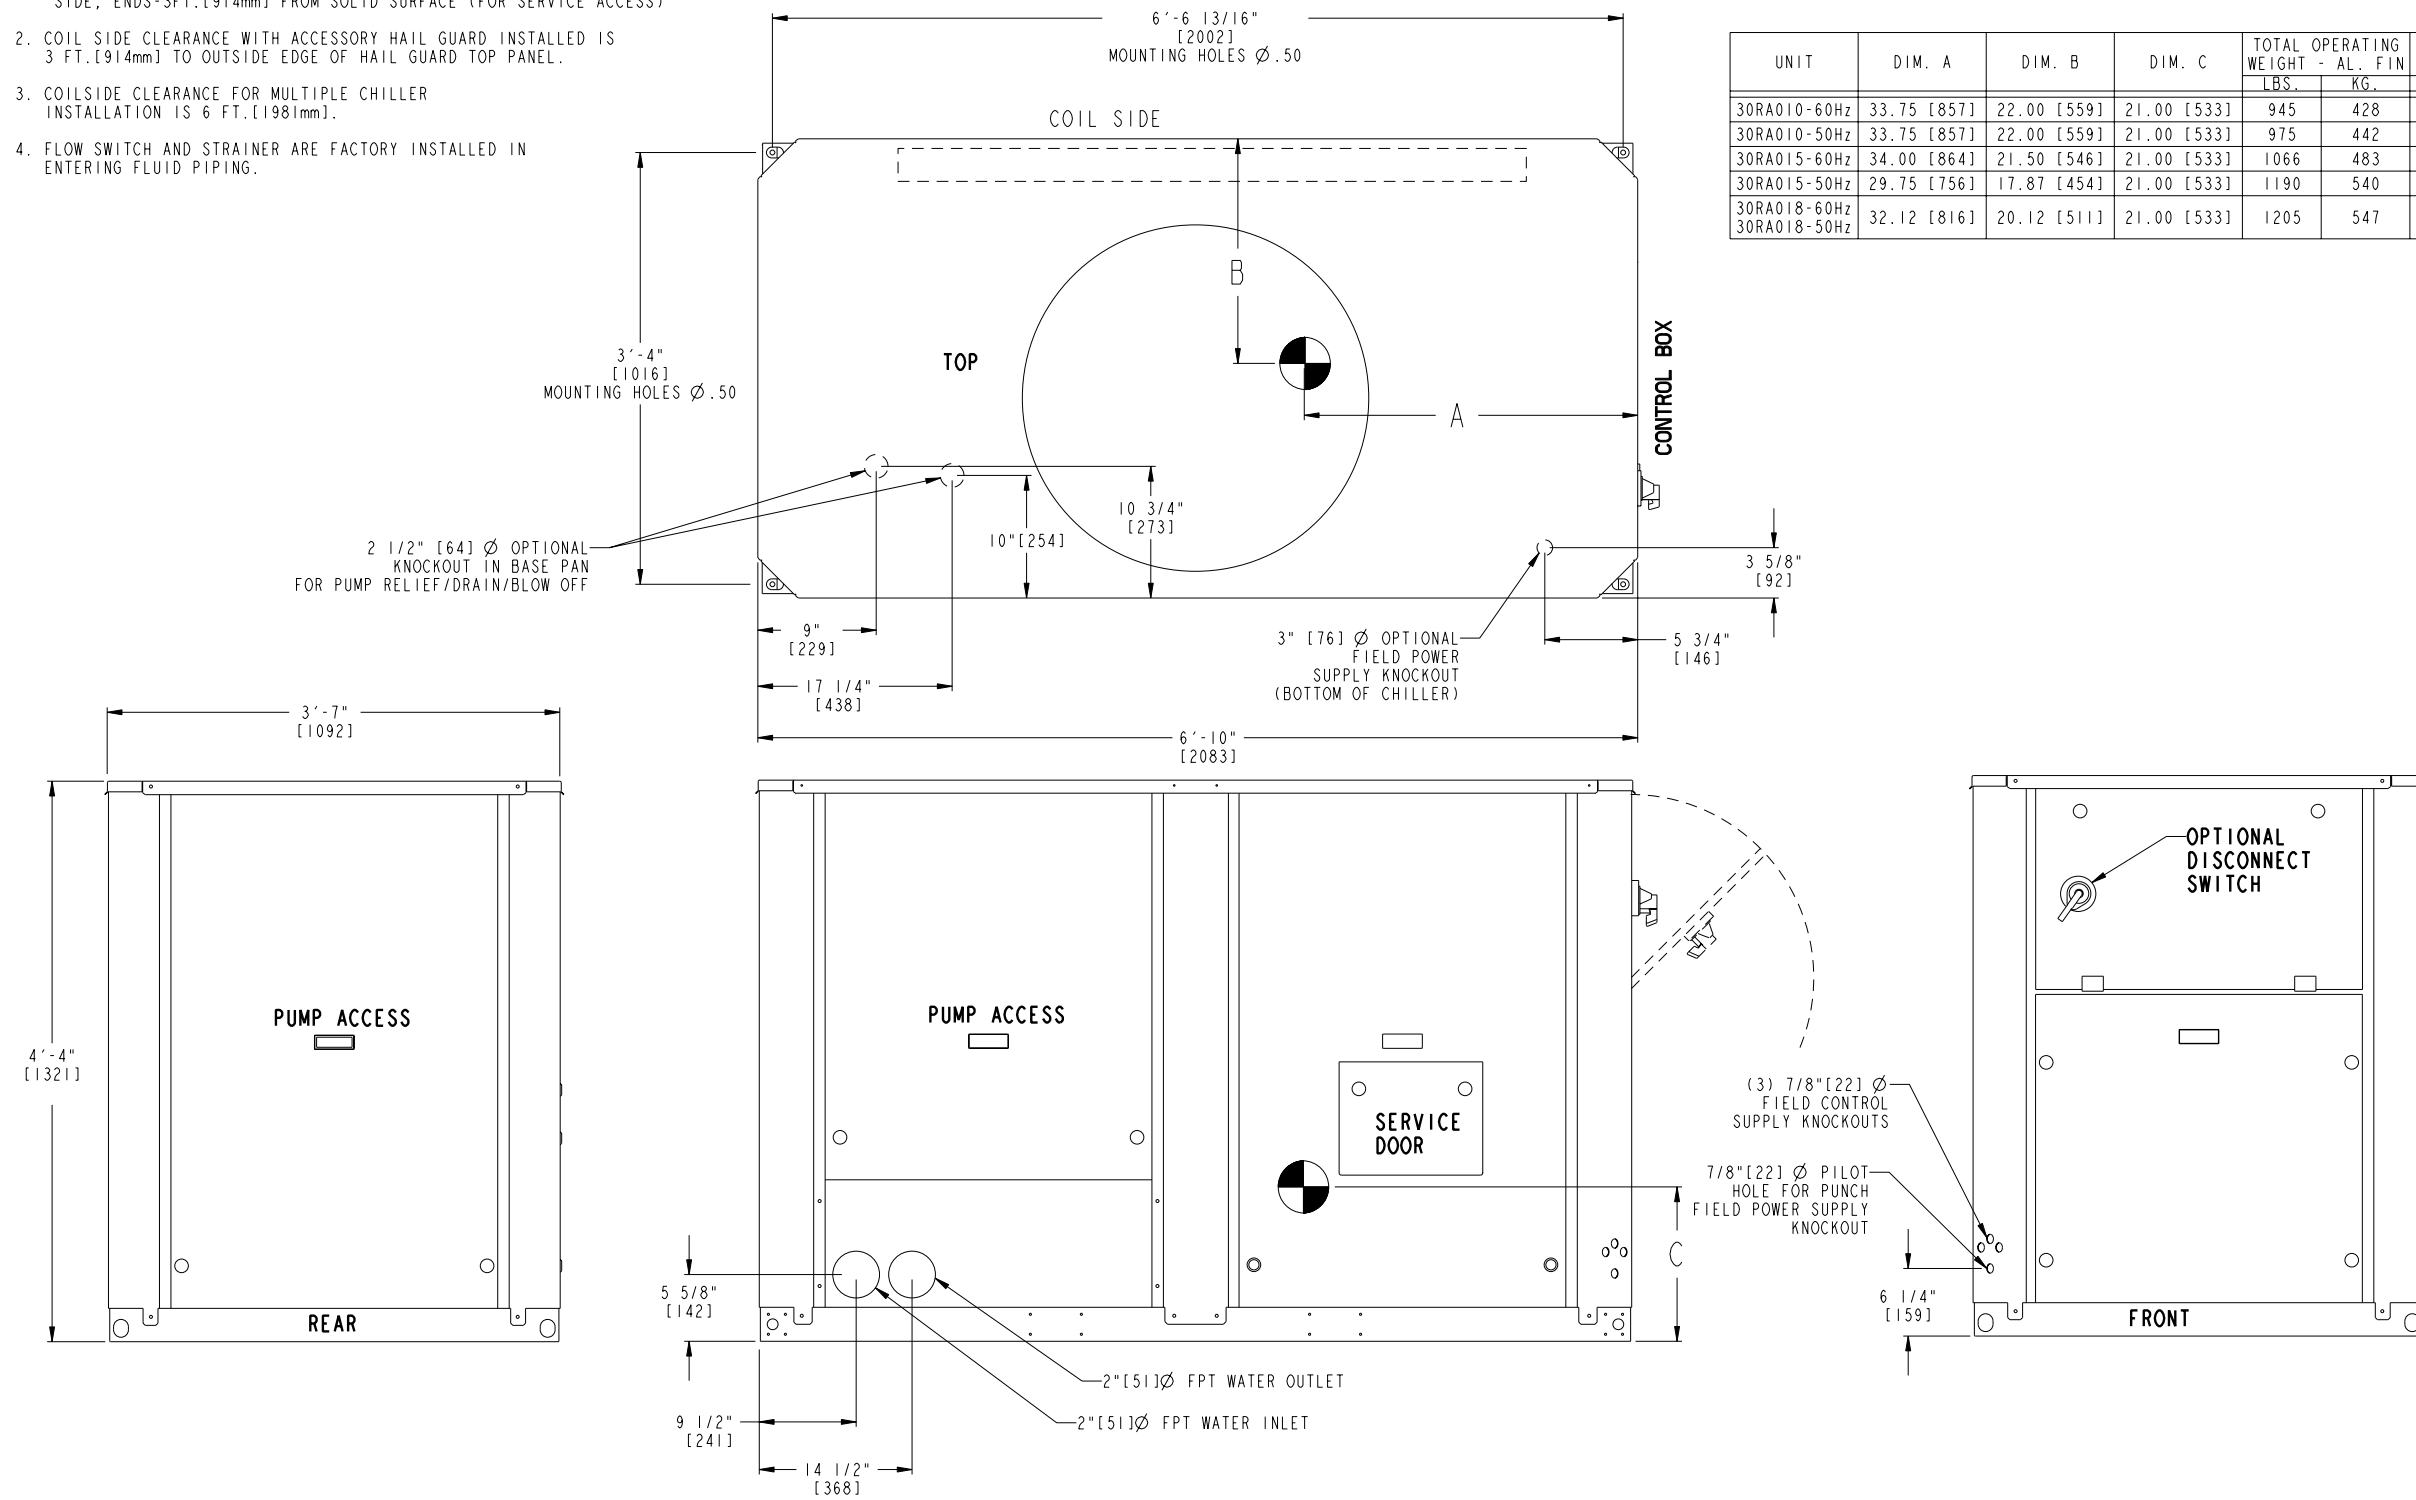

DATE 03/12/01	SUPERCEDES NEW	30RA010,015,018 AQUASNAP CHILLER	30RA500279	REV 2.0
------------------	-------------------	----------------------------------	------------	------------