UNITED TECHNOLOGIES CARRIER P.O. BOX 4808 SYRACUSE, NY 13221

THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

NOTES:
1. UNIT MUST HAVE CLEARANCES FOR AIRFLOW AS FOLLOWS:
   TOP-DO NOT RESTRICT IN ANY WAY
   COIL SIDE- 3 1/2 FT.[1067mm] FROM SOLID SURFACE
   SIDE, ENDS-3FT.[914mm] FROM SOLID SURFACE (FOR SERVICE ACCESS)

2. COIL SIDE CLEARANCE WITH ACCESSORY HAIL GUARD INSTALLED IS 3 FT.[914mm] TO OUTSIDE EDGE OF HAIL GUARD TOP PANEL.

3. COILSIDE CLEARANCE FOR MULTIPLE CHILLER INSTALLATION IS 6 FT.[1981mm].

4. STRAINER IS FACTORY INSTALLED IN ENTERING FLUID PIPING. FLOW SWITCH IS FACTORY INSTALLED IN LEAVING FLUID PIPING.

UNIT	TOTAL OPERATING WEIGHT - AL.FIN		TOTAL OPERATING WEIGHT - CU.FIN	
	LBS.	KG.	LBS.	KG.
30RA055-60Hz	3495	1585	3946	1790

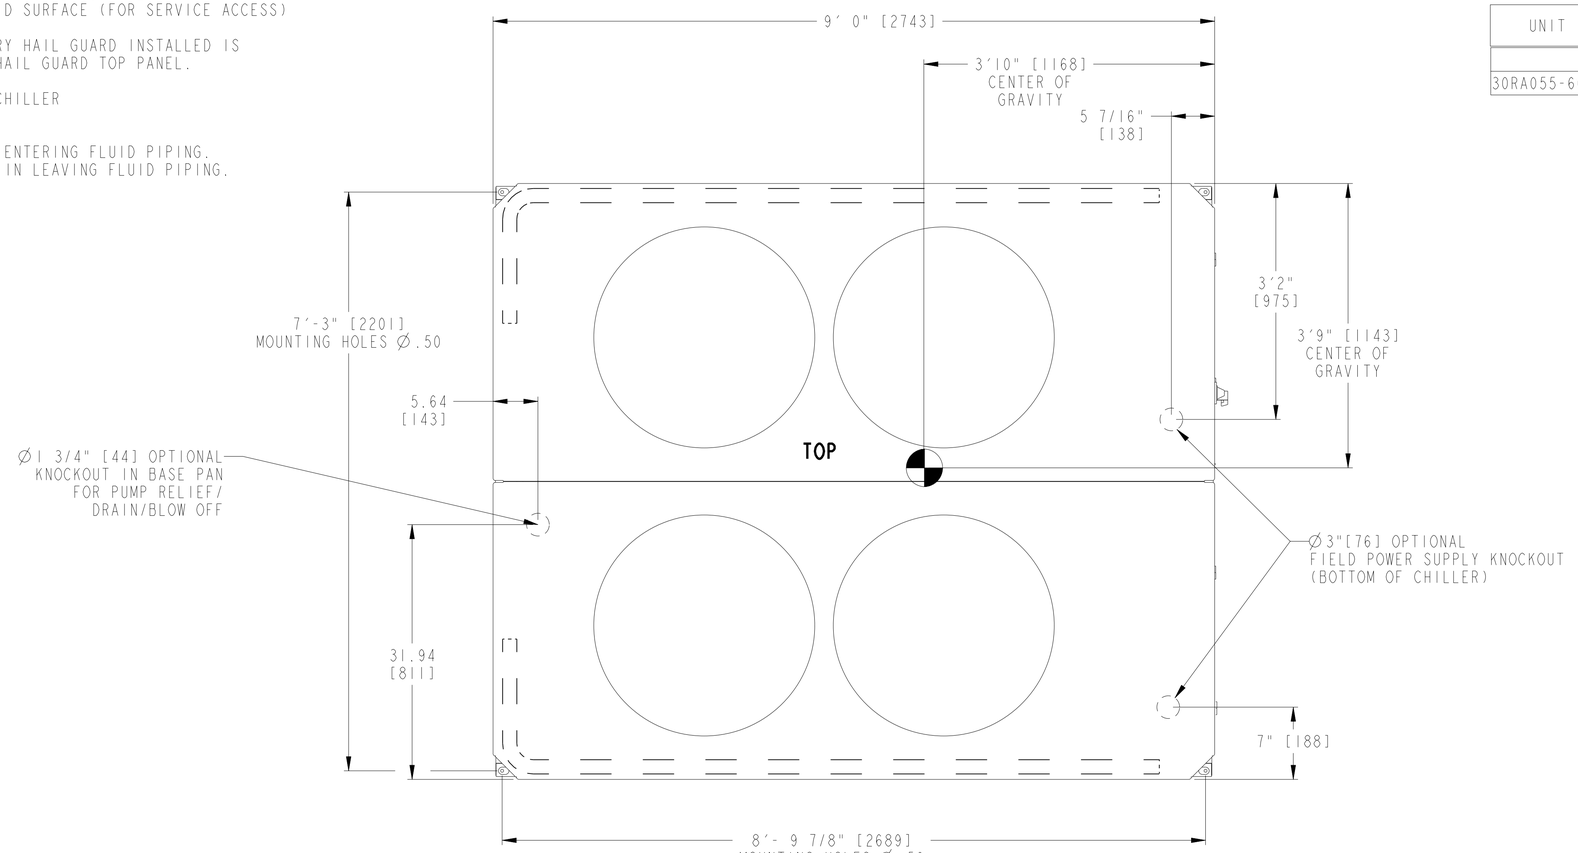

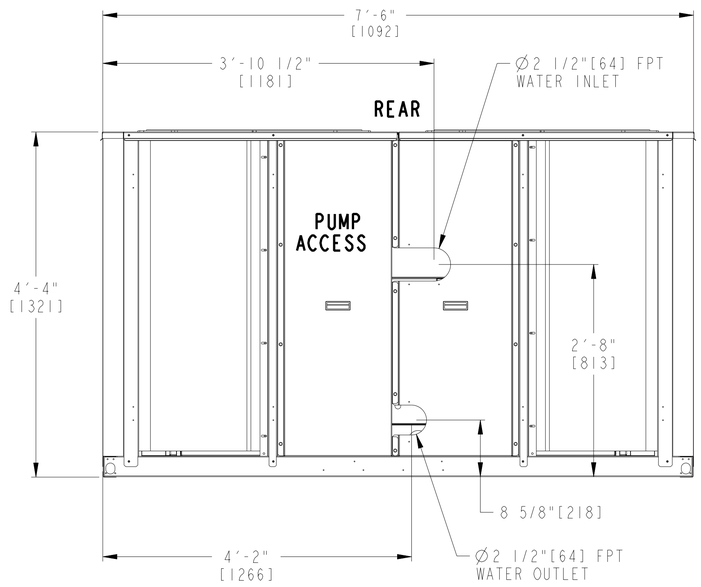

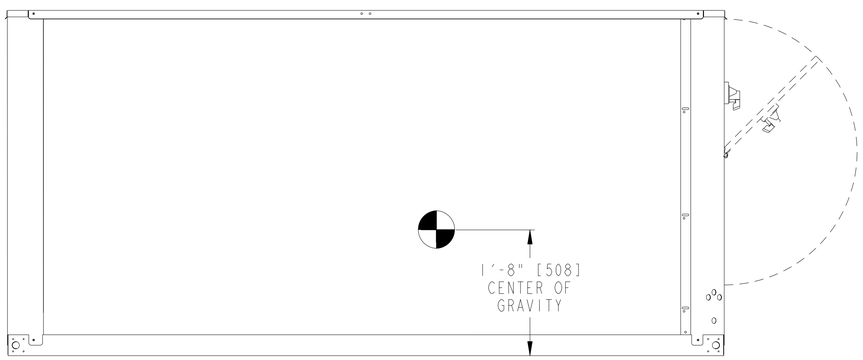

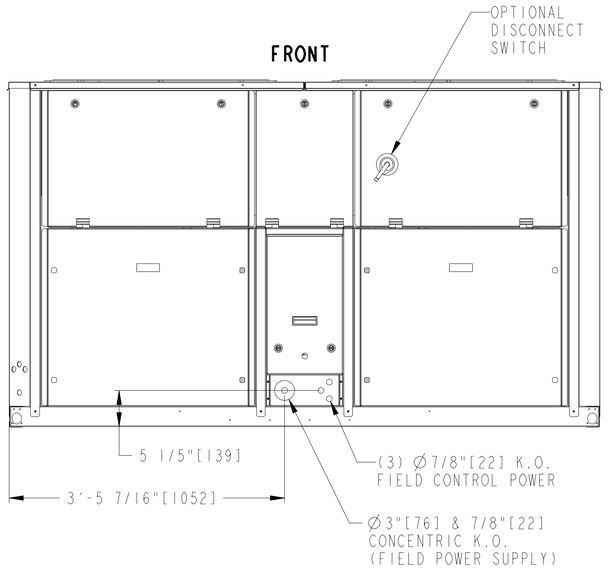

DATE	SUPERCEDES		
03/26/01	3/22/01	30RA 055 AQUASNAP CHILLER	30RA500643	REV 3.0