



### Control panel of Chiller(/heater)




Input current : DC 4-20mA  
 Cooling mode : +0 to +5°C  
 Heating mode : -0 to -10°C (TSA-16DJ only)

### Remote setting of chilled(/hot) water outlet temperature

Set point of chilled(/hot) water outlet temperature is offset by remote control panel such as central monitoring panel.

### Setting mode

Cooling mode : Set point + Offset dt (below the maximum set point)  
 Heating mode : Set point - Offset dt (above the minimum set point) (TSA-16DJ only)

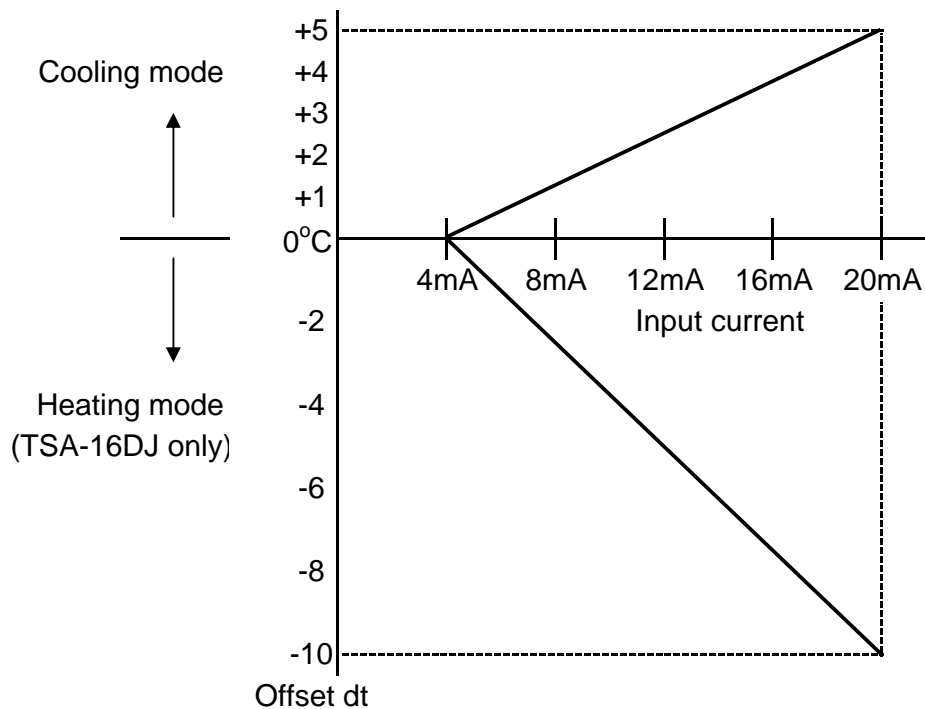

- 1) Should be work the electric wiring connection by license holder.
- 2) Use steel conduit for electric wiring between field electric supply and chiller control panel.



Remote setting of  
Chilled water outlet temp.

Model  
All model  
Drawing code  
CM-032-011-00-0